REVISIONS				
ZONE	LTR	DESCRIPTION	DATE	APPROVED

DUST COVER
REMOVED FOR CLARITY

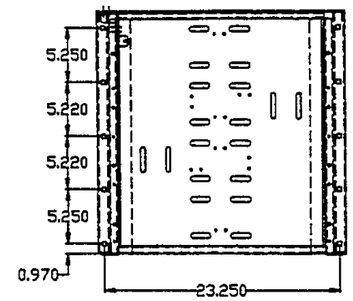

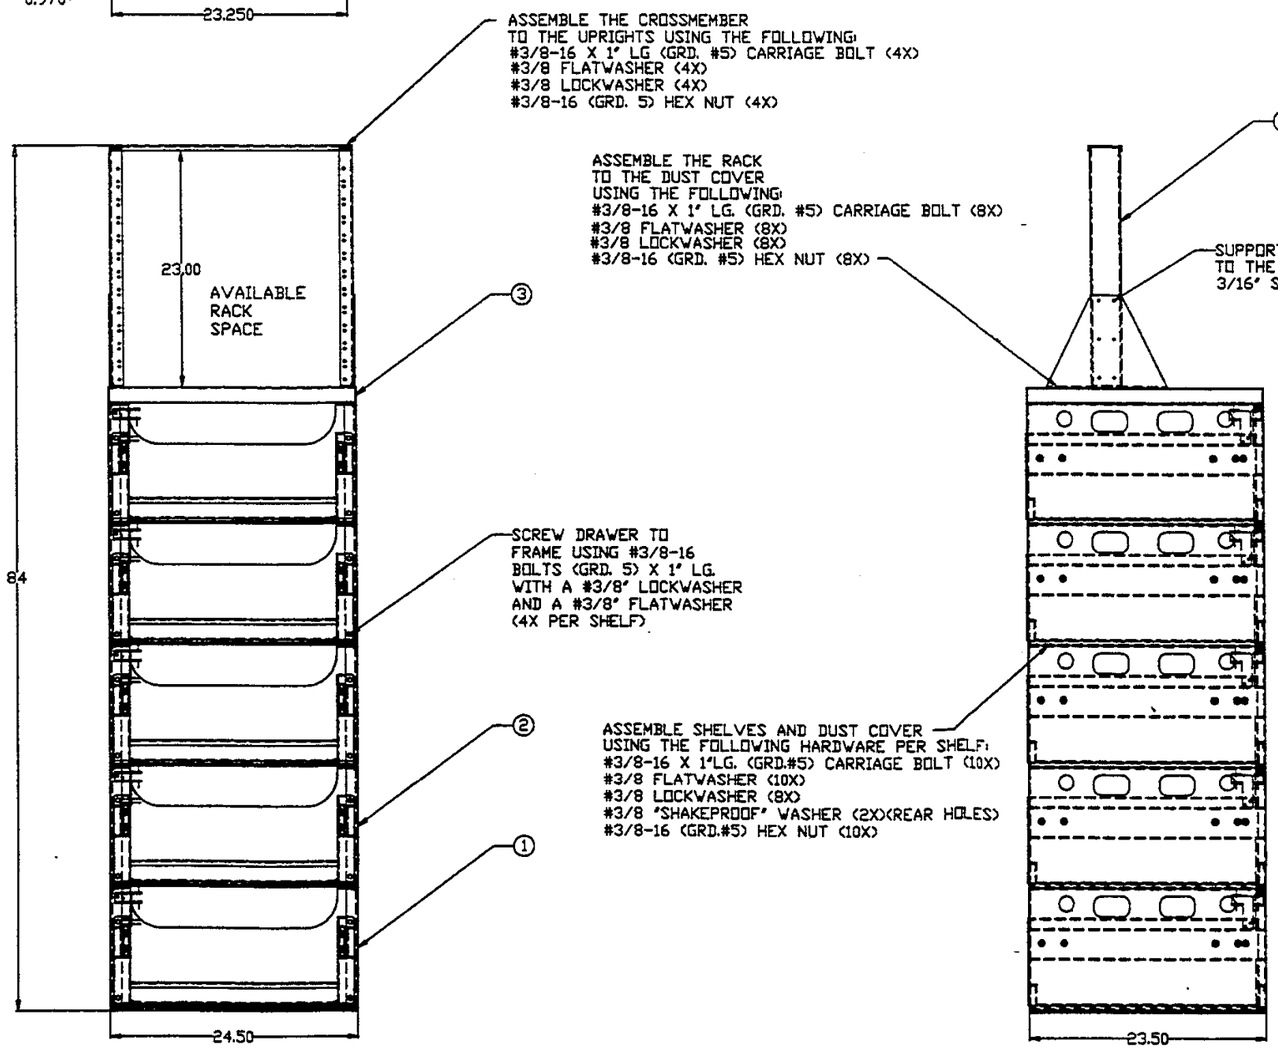

NOTES:
FINISH-EPOXY POWDER, ASA 61 GREY

ASSEMBLY IS QUALIFIED AND
CERTIFIED FOR UBC SEISMIC ZONE 4

COVER INCLUDES RELAY RACK MOUNTING
HOLES

* BATTERY HOLDOWNS AS REQ.

THIS DOCUMENT CONTAINS PROPRIETARY DATA OF SMFI AND JCI. NO DISCLOSURE, REPRODUCTION, OR USE OF ANY PART THEREOF MAY BE MADE WITHOUT WRITTEN PERMISSION. THIS IS A CAD GENERATED DRAWING. NO MANUAL CHANGES ALLOWED.

BILL OF MATERIALS

QTY	ITEM	PART NUMBER	DESCRIPTION
1	6	MRR4-2350	RACK "J"
* 20	5	MHD70-90	BATTERY HOLDOWN (NOT SHOWN)
* 10	4	MHD30-45	BATTERY HOLDOWN (NOT SHOWN)
1	3	MRDC-S	DUST COVER
4	2	MRT-S	Z-4 SLIDING BATTERY SHELF-TIER
1	1	MRB-S	Z-4 SLIDING BATTERY SHELF-BASE

CONTR.	JOHNSON CONTROLS, INC. SPECIALTY BATTERY
DRAWN RVG 6/28/97	(TEL12-30/12-90) Z-4 MODULAR SINGLE BAY SYSTEM - 5 TIER W/RELAY RACK
CHECKED	
APPROVED	
APPROVED	
DSGN ACT APPVL	SIZE D · CODE IDENT NO. · DRAWING NO. SBMS-5TR · REV. -
GOV'T ACT APPVL	SCALE: · SHEET 1 OF 1

UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES TOLERANCES: FRACTIONS ±1/16 ANGLES ±1 DEG. 2 PLACE DECIMALS ± .010 3 PLACE DECIMALS ± .005

MATERIAL: AS NOTED

FINISH: AS NOTED

NEXT ASS'Y	USED ON
APPLICATION	